

Leda Care Invisi Series II®

Sanitary Compartment For People with Ambulant Disabilities

4.5/3 litre Dual Flush Toilet Suite with Wall Faced Pan and Invisi Series II® Cistern



The 4.5/3 dual flush **Leda Care Invisi Series II®** matched suite is designed to provide a raised seat height of between 460-480mm. This suite is suitable for compliance to AS 1428.1-2009 Amd. 1 for ambulant applications. The pan connection system includes the patented Caroma Uni-Orbital® connector that extends to any position in a 25mm radius, unlike traditional connectors that only move backwards and forwards. The setout range is from 60mm – 170mm with a recommended setout of 90mm. Concealed cistern and plumbing fittings provide space saving, ease of cleaning and performance matched components to maximise flushing efficiency.

Important : Reference must be made to **AS 1428.1-2009 with current amendments for people with ambulant disability requirements. The dimensions in this sheet may change with amendments to the standard.**


- Pan:** Leda Care 4.5 litre full flush wash down box rim type.
- Traps:** Universal trap.
- Inlet:** 50mm back inlet. A 40mm kee-seal is available.
- Cisterns:** **Invisi Series II®** cistern – suitable for inwall, induct and inceiling applications. **Important: Working pressure minimum 30kPa to maximum 1000kPa flow pressure. Rain water tank compliant.**
- Buttons:** Sold separately; See Section 16 - **BUTTONS** for further details.
- Seats:** **Caravelle Care** single flap or **Caravelle Care** double flap seat is provided as standard with this suite, and are available in Caroma White (W), Sorrento Blue (SB) and Anthracite Grey (AG). See Section 15 - **SEATS** for further details. Reference to AS1428.1-2009 must be made in regards to luminance contrast when selecting the seat colour.



- Position of the Pan:** For people with ambulant disabilities the pan can be positioned directly to the existing wall.
- Colour:** Pan available in white only.
- Installation:** The installation of the toilet suite shall be in accordance with the normal minimum drainline grade requirements in AS/NZS 3500.2.
- Dimensions:** All dimensions are in millimetres and are subject to normal manufacturing variations. Caroma pursues a policy of continuing improvement in design and performance of its products. The right is therefore reserved to vary specifications without notice.

Note: The projection requirements for people with ambulant disabilities is 610 to 660mm.

Leda Care Invisi Series II® Toilet Suite with Seat:	Code No.	Seat colour:
Caravelle Care Single Flap Seat	719105	W, SB or AG
Caravelle Care Single Flap Seat with Backrest Curved Arm	719105B	W, SB or AG
Caravelle Care Double Flap Seat	719100	W or SB

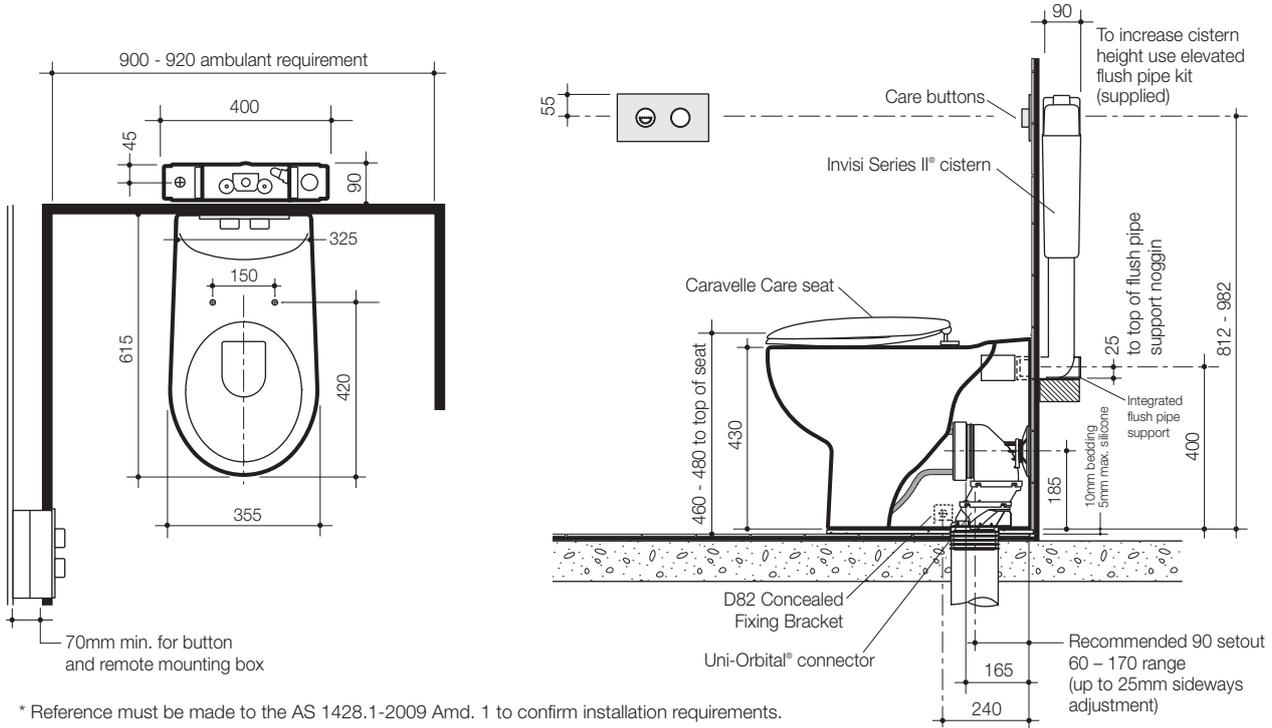

* Reference must be made to the AS 1428.1-2009 Amd. 1 to confirm installation requirements.