



CAROMA

DESIGN PICCOLO - WALL BASIN OUTLET

WATER EFFICIENT TAPWARE

PLUMBERS INSTALLATION INSTRUCTIONS

Important Information

- * Not suitable for gravity feed systems.
- * **HOT & COLD WATER INLET PRESSURES MUST BE EQUAL.**
- * **Outlet is fitted with a flow regulated aerator (7). This low flow rate may not be suitable for connection to some Instantaneous Gas Water Heaters, some Tempering Valves, some Solar Water Heaters & some Thermostatic Mixing Valves. Check with the manufacturers of these products.**
- * **All pipework must be thoroughly flushed prior to installation, as foreign materials may block the flow regulating device and reduce the flow of water.**

Installation (Fig.1)

- 1) Check that threaded nipple (1) is the correct length, as shown. Cut to length if required ensuring end face is square. Apply thread tape to the thread.
- 2) Slide the cover plate (4) together with the seal (3) and 'O'Ring (5) over the spout (2) as shown. Remove the backing tape from the foam seal (3). Carefully screw the spout (2) onto the threaded nipple (1) until the threaded end is close to the wall/tile face and the aerator insert (6) is pointing down as shown, taking care not to damage the decorative finish. **DO NOT OVERTIGHTEN.**
- 3) Slide the cover plate (4) along the outlet (2) until it firmly contacts the wall/tile face.

Servicing Aerator Insert

- 1) Carefully remove aerator housing (8) from spout (2), taking care not to damage the decorative finish.
- 2) Remove seal (6) & aerator insert (7) from aerator housing. Check that aerator housing is clean. Deposits of lime can be removed by washing in a vinegar solution.
- 3) Replace aerator insert (7) into aerator housing (8) followed by seal (6) then screw assembly into spout (2) and tighten securely (to prevent removal by hand).

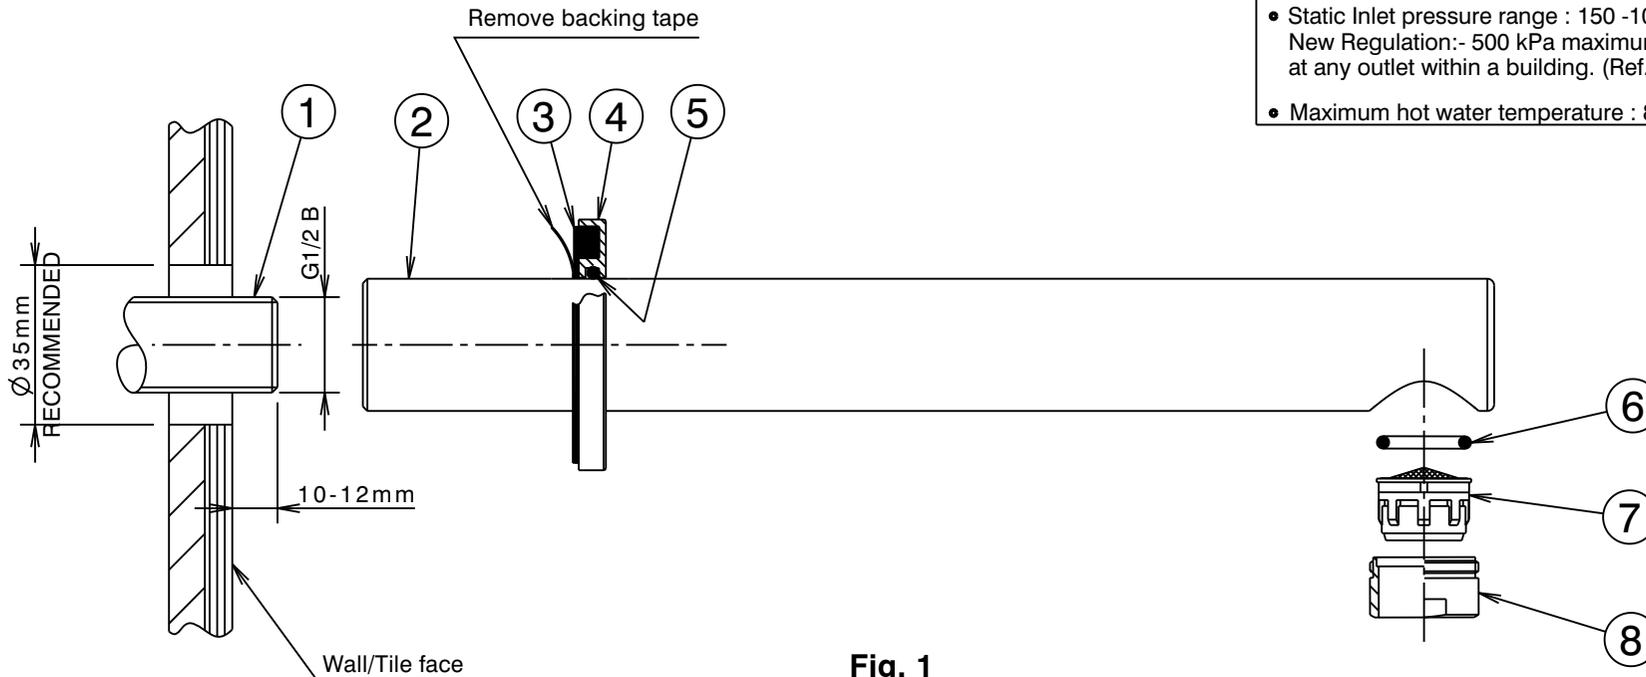


Fig. 1

IMPORTANT

Pressure & Temperature Requirements.

- Hot and cold water inlet pressures should be equal.
- Static Inlet pressure range : 150 -1000 kPa
New Regulation:- 500 kPa maximum static pressure at any outlet within a building. (Ref. AS/NZS 3500.1)
- Maximum hot water temperature : 80°C.